


Gravity Grease Interceptor 25% Rule Calculation

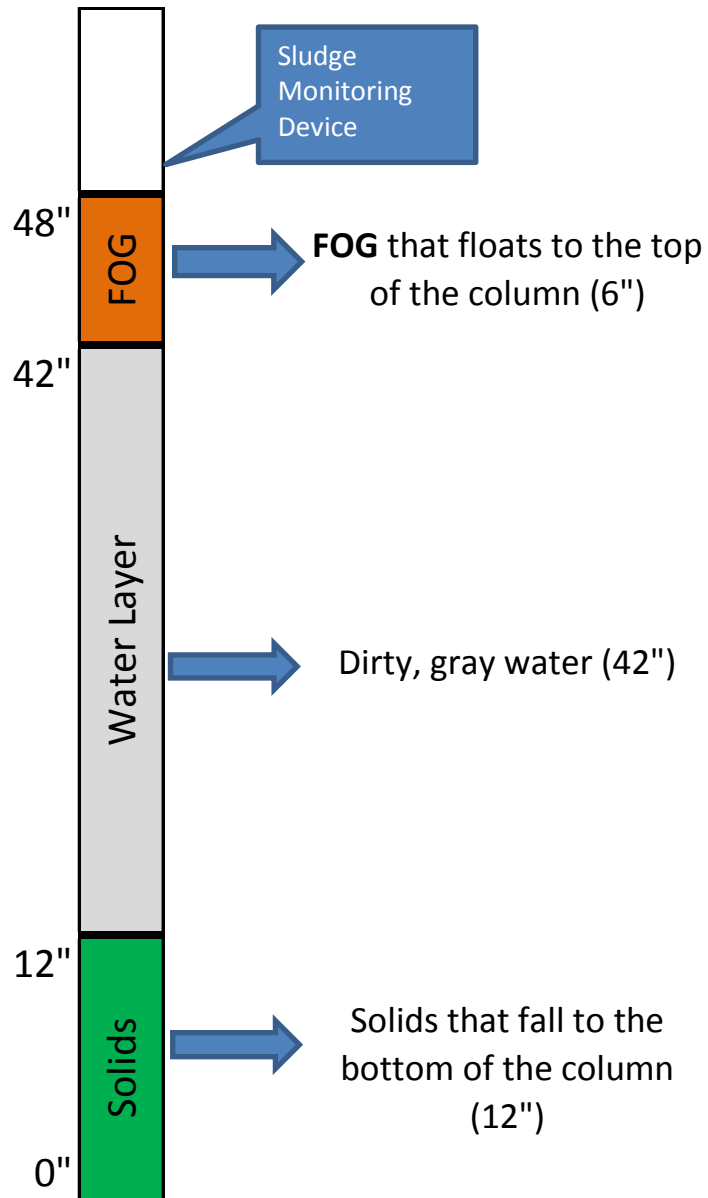

Does this example meet the 25% rule?

- Total FOG at top of column = 6"
- Total solids at bottom of column = 12"
- Total depth of entire column = 48"

*Percentage of FOG + Solids

$$\frac{(\text{FOG} + \text{solids})}{\text{Depth of entire column}} \times 100 =$$

$$\frac{(6'' + 12'')}{48''} \times 100 = 37.50\%$$

→ **Answer: No, the 25% rule is not met and the FSE needs to increase pumping frequency.**

* Sampling for the 25% rule should be conducted on the inlet side of the interceptor. Average the values from three evenly spaced samples.