



TWO (2) ADDITIONAL #5's AT
OPENING IN THE TOP OF SLAB.

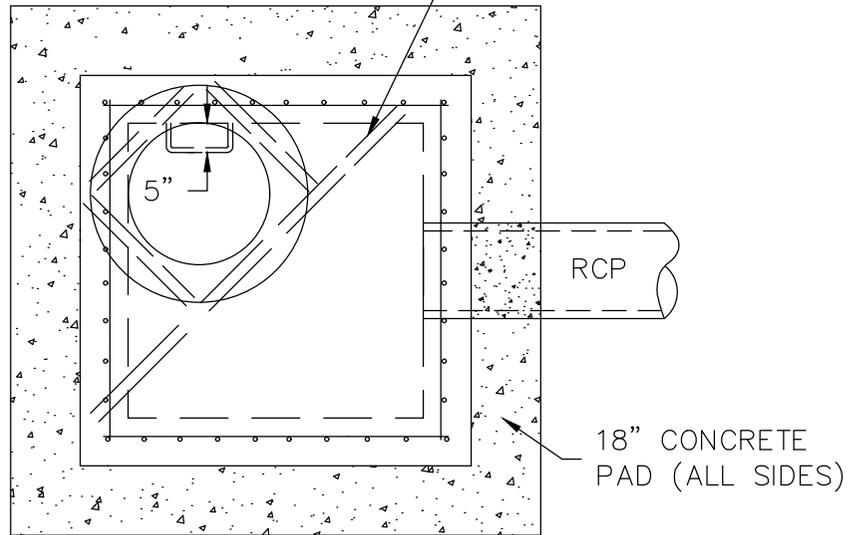

PLAN VIEW

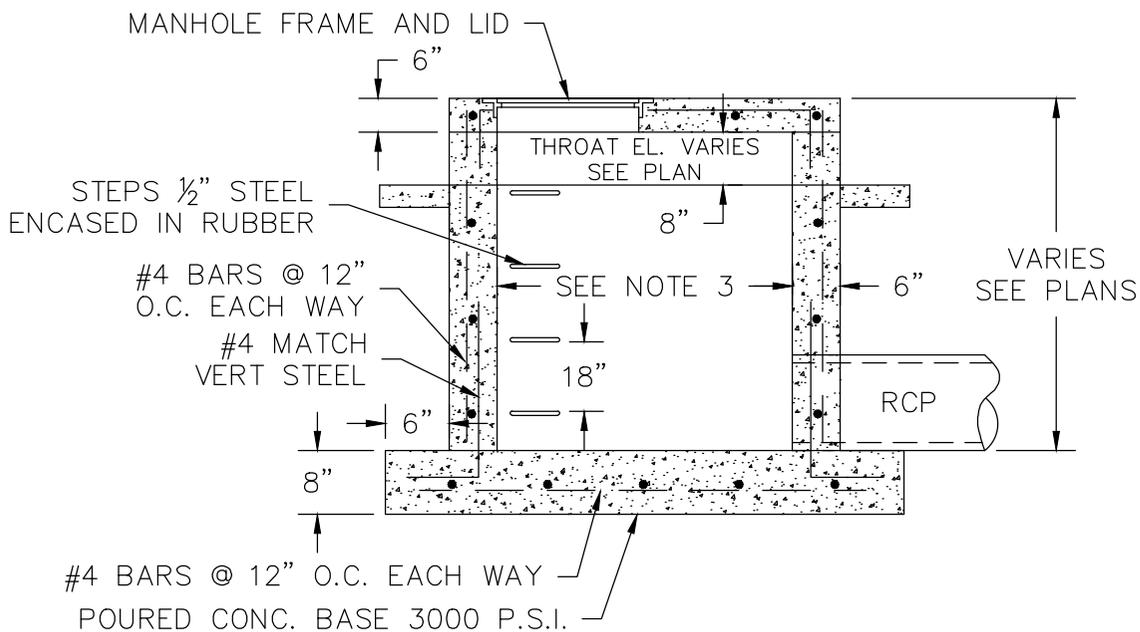

SECTION

NOTES:

- 1) WITH APPROVAL OF THE ENGINEER, PRECAST STRUCTURES MAY BE USED IN LIEU OF CAST IN-PLACE JUNCTION BOXES AND AREA INLETS. PRECAST STRUCTURES SHALL CONFORM TO THE REQUIREMENTS OF ASTM C478, LATEST REVISION.
- 2) REFER TO DETAIL NO. 03-106 FOR FRAME AND LID.
- 3) INTERIOR LENGTH AND WIDTH OF INLET SHALL BE A MINIMUM OF 48" FOR 24" PIPE OR LESS. IF PIPE DIAMETER IS GREATER THAN 24", MINIMUM INTERIOR LENGTH AND WIDTH OF INLET SHALL BE PIPE DIAMETER PLUS 24".

AREA INLET DETAIL

NOT TO SCALE

DETAIL NO: 03-104

REV. DATE: 10.3.19