


NOTES:

1. ALL CONCRETE SHALL BE 3000 PSI 28 DAY COMPRESSIVE STRENGTH.
2. ALL REINFORCING STEEL SHALL BE GRADE 60 ASTM A615 OR A617.
3. ALL REINFORCING STEEL AND ACCESSORIES SHALL BE DETAILED, FABRICATED AND PLACED IN ACCORDANCE WITH THE LATEST EDITION OF THE ACI MANUAL, "MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES."
4. REINFORCING SHALL BE #4 BARS AT 12" ON CENTER EACH WAY IN ALL WALLS AND SLABS.
5. INTERIOR LENGTH AND WIDTH OF INLET SHALL BE A MINIMUM OF 48" FOR 24" PIPE OR LESS. IF PIPE DIAMETER IS GREATER THAN 24", MINIMUM INTERIOR LENGTH AND WIDTH OF INLET SHALL BE PIPE DIAMETER PLUS 24".

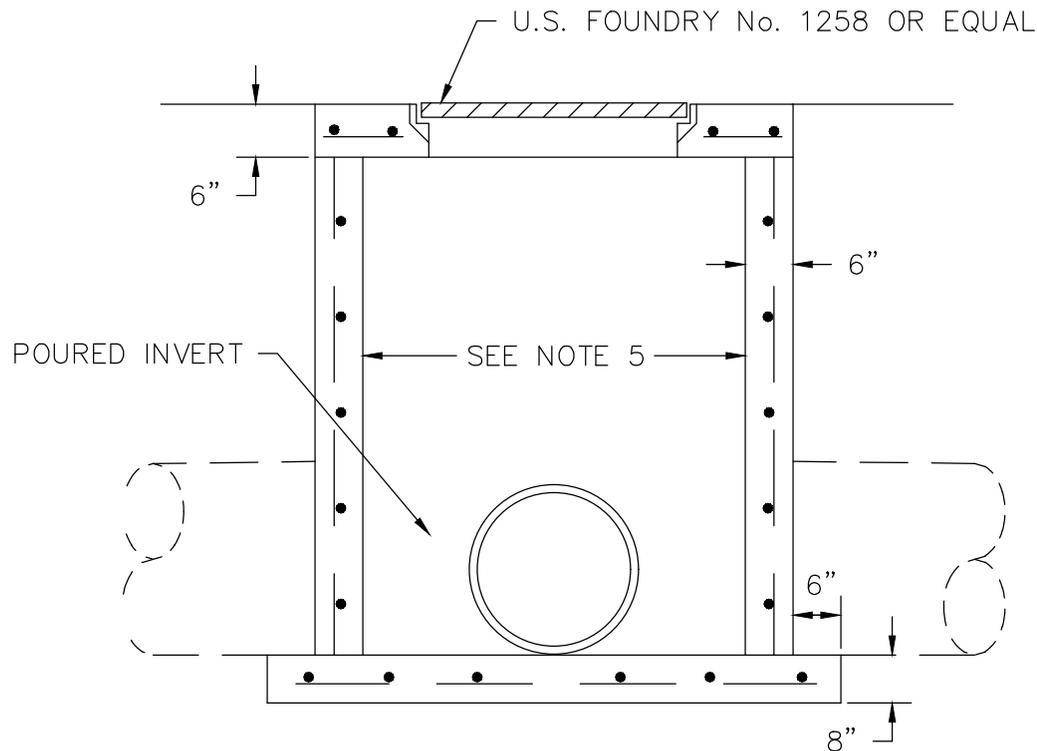

JUNCTION BOX DETAIL

NOT TO SCALE

DETAIL NO: 03-105

REV. DATE: 10.3.19